

CMRI CERT NO. :- CIMFR/TC/SR/H483
SUPPLE. T.C. NO. :- CIMFR/TC/S/H144
CAT. NO./TYPE NO. :- KJB-A-03

TECHNICAL DATA

ENCLOSURE :-
EX-d AS PER IS/IEC 60079-1:2007

PROTECTION :-
IP-66 AS PER IS 12063-1987 (IS/IEC 60529:2001)

AREA CLASSIFICATION :-
ZONE -1 & 2

TEMPERATURE CLASS :-
T6

GAS GROUPS :-
IIB



MATERIAL OF CONSTRUCTION :-
DIE CAST AL. ALLOY LM-6

HARDWARE :-
STEEL ZINC PLATED/STAINLESS STEEL

FINISH :-
LIGHT GREY

EARTHING :-
1 NO. INSIDE & 2 NOS. OUTSIDE

CABLE ENTRY :-
M20x1.5P / 3/4"ET - 2NOS.

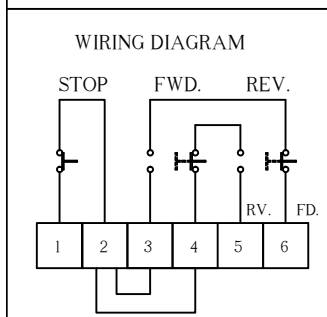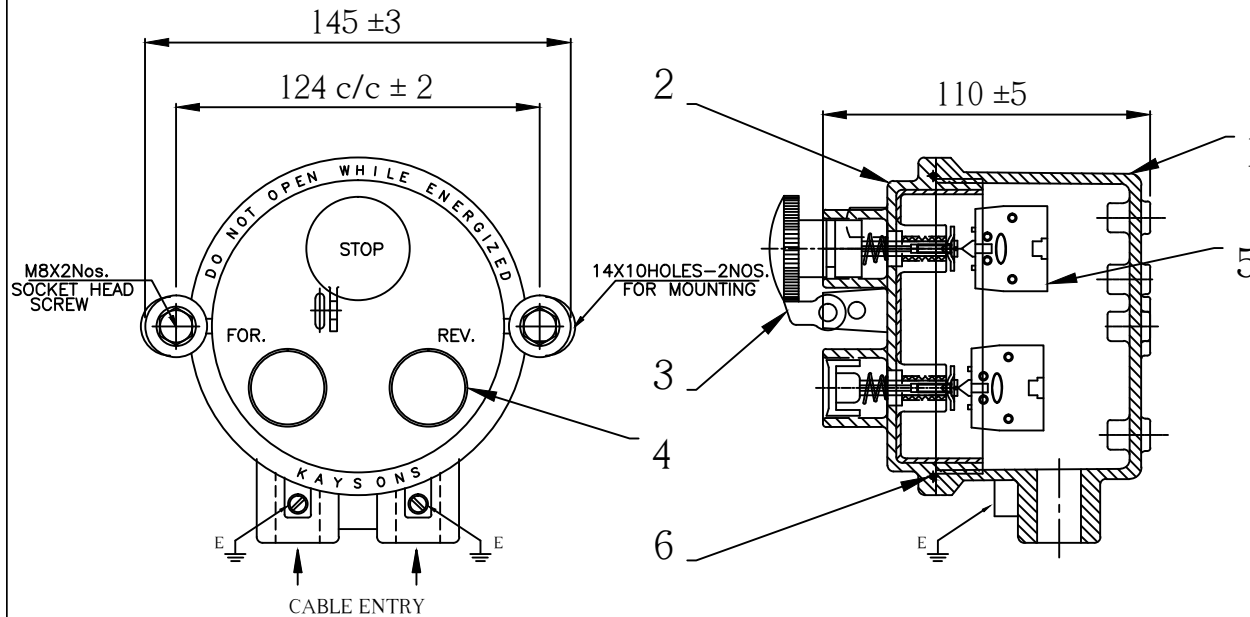

06.	GASKET (ENDLESS, MOULDED)	1	NEOPRENE
05.	CONTACT ELEMENTS (1NO+1NC)	3	-
04.	ACTUATOR GREEN & YELLOW SHROUDED	2	P.P.
03.	ACTUATOR RED-MUSHROOM HEAD	1	P.P.
02.	MAIN BODY COVER	1	DIE CAST AL. ALLOY
01.	BODY	1	DIE CAST AL. ALLOY
NO.	DESCRIPTION	QTY	MAT./RATING

CLIENT :-	DRAWN KBP 1.8.13	DESCRIPTION:- FLP WP CONTROL STATION WITH FOR-REV-STOP PUSH BUTTON	
CONSULANT :-	APP'D HPB 1.8.13		
P.O.NO. :-	CH'D NPB 1.8.13		
KAYSONS TECHNO EQUIPMENTS PVT LTD		1802/7, G.I.D.C. ESTATE, V.U.NAGAR 388121. (GUJARAT)	SHT.NO. 1 OF 1
ISSUE DATE BY MODIFICATION			REV. 0
			DRG.NO.:- B24

THE INFORMATION CONTAINED IN THIS DRAWING IS THE PROPERTY OF KAYSONS TECHNO EQUIPMENTS PVT. LTD. AND IS NOT TO BE COPIED OR MISUSED IN ANY WAY.