

CMRI CERT NO.:- CIMFR/TC/P/H517
 SUPPLE. T.C. NO.:- CIMFR/TC/S/H182
 CAT.NO.:- KIB-1-DF-MS

TECHNICAL DATA

ENCLOSURE :-
 EX-d AS PER IS/IEC 60079-1:2007
 SUITABLE FOR INSTALLATION IN HAZARDOUS LOCATION

PROTECTION :-
 IP-55 AS PER IS 12063-1987(IEC 60529:1989)

AREA CLASSIFICATION :-
 ZONE -1 & 2

GAS GROUPS :-
 IIB

TEMPERATURE CLASS :-
 T6


MATERIAL OF CONSTRUCTION :-
 CAST AL ALLOY LM-6

HARDWARE :-
 STEEL ZINC PLATED/STAINLESS STEEL

FINISH :-
 LIGHT GREY

EARTHING :-
 1 NO. INSIDE & 2 NOS. OUTSIDE

CABLE ENTRY :-
 TO BE SPECIFIED WHILE ORDERING.

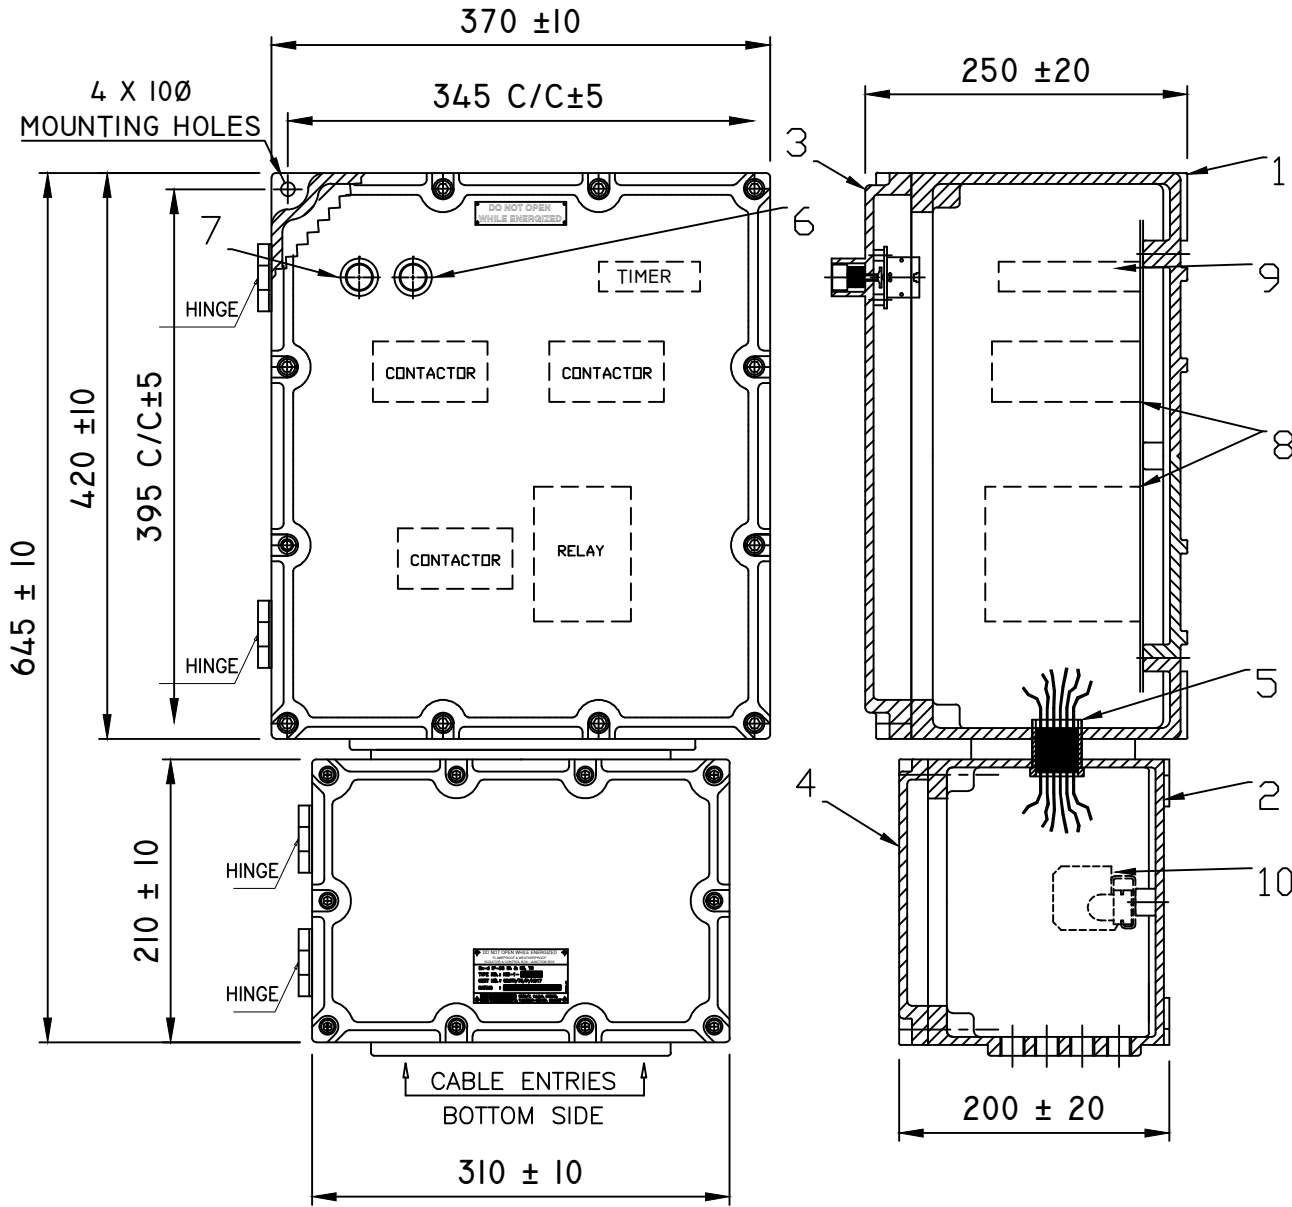

10.	TERMINAL	A.R.	CLIPON TYPE RAIL MOUNTED
09.	TIMER	1	A.R
08.	AUX. CONTACTOR	2	A.R
	POWER CONTACTOR & O/L RELAY	1SET.	A.R
07.	STOP PUSH BUTTON ACTUATOR	1	P.P
06.	START PUSH BUTTON ACTUATOR	1	P.P
05.	WIRE BUSH	1	GLASSFEEL NYLONE
04.	TERMINAL BODY COVER	1	CAST AL. ALLOY
03.	MAIN BODY COVER	1	CAST AL. ALLOY
02.	TERMINAL BODY	1	CAST AL. ALLOY
01.	MAIN BODY	1	CAST AL. ALLOY
NO.	DESCRIPTION	QTY	MAT./RATING

CLIENT :-		DRAWN	KBP	1.8.13	DESCRIPTION:-	
CONSULTANT :-		APP'D	HPB	1.8.13	FLAMEPROOF WEATHERPROOF STAR DELTA STARTER UPTO 40 HP	
P.O.NO. :-		CH'D	NPB	1.8.13		
THE INFORMATION CONTAINED IN THIS DRAWING IS THE PROPERTY OF KAYSONS TECHNO EQUIPMENTS PVT. LTD. AND IS NOT TO BE COPIED OR MISUSED IN ANY WAY.		ISSUE	DATE	BY	MODIFICATION	
		KAYSONS TECHNO EQUIPMENTS PVT LTD			1802/7, G.I.D.C. ESTATE, V.U.NAGAR 388121. (GUJARAT)	SHT.NO. 1 OF 1
						REV. 0
						DRG.NO.:- G04