

TECHNICAL DATA

ENCLOSURE :-
 EX-d AS PER IS/IEC 60079-1:2007
 SUITABLE FOR INSTALLATION IN HAZARDOUS LOCATION

PROTECTION :-
 IP-55 AS PER IS 12063-1987(IEC 60529:1989)

AREA CLASSIFICATION :-
 ZONE -1 & 2

GAS GROUPS :-
 IIB

TEMPERATURE CLASS :-
 T6


MATERIAL OF CONSTRUCTION :-
 CAST AL ALLOY LM-6

HARDWARE :-
 STEEL ZINC PLATED/STAINLESS STEEL

FINISH :-
 LIGHT GREY

EARTHING :-
 1 NO. INSIDE & 2 NOS. OUTSIDE

CABLE ENTRY :-
 TO BE SPECIFIED WHILE ORDERING.

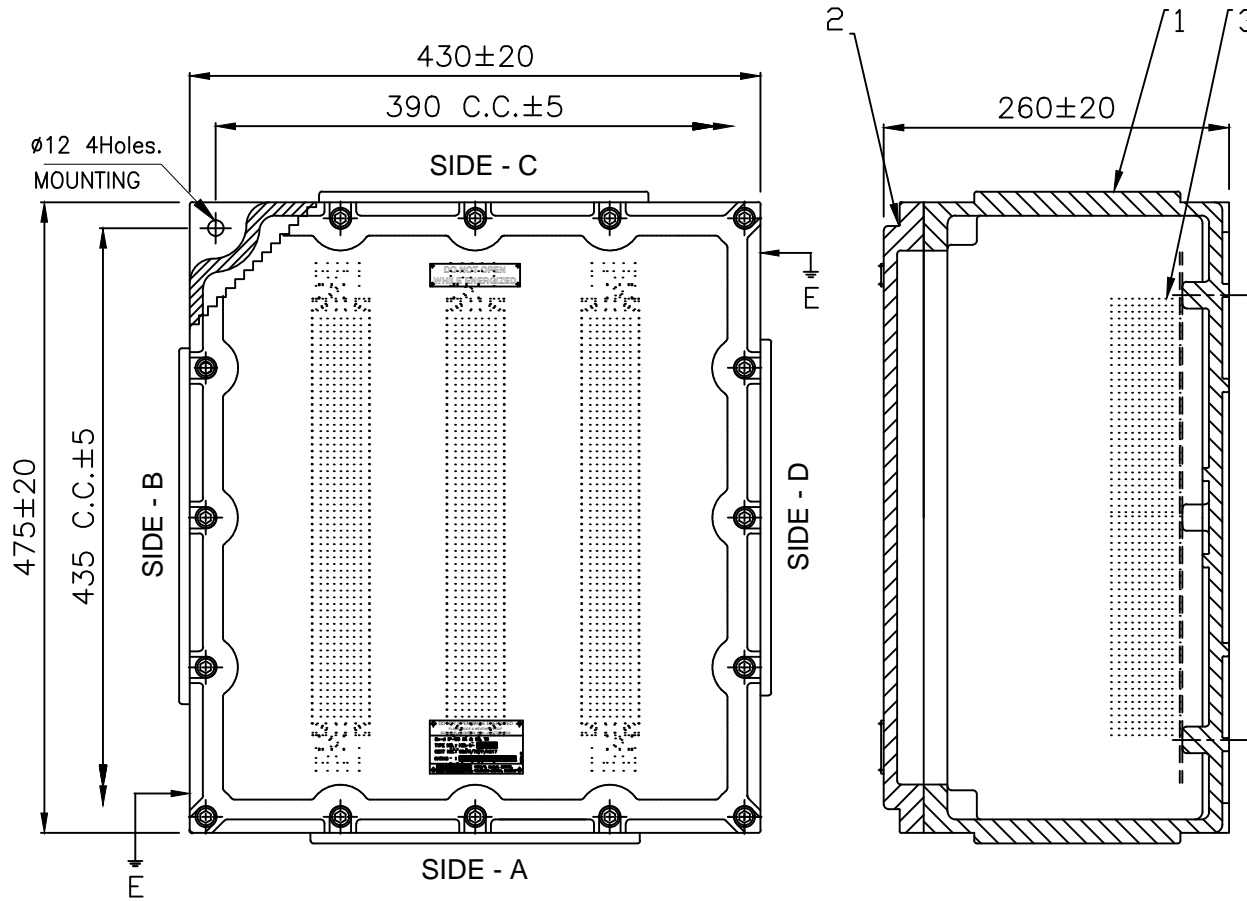

CABLE ENTRY & TERMINAL DETAILS

SR. NO.	TAG NO.	NO. OF CABLE ENTRY	NO. OF TERMINAL	QTY.

NO.	DESCRIPTION	QTY	MAT./RATING	SR. NO.	TAG NO.	SIDE-A	SIDE-B	SIDE-C	SIDE-D	NO. OF TERMINAL	QTY.
03.	TERMINAL										
02.	COVER	1	CAST AL. ALLOY								
01.	BODY	1	CAST AL. ALLOY								

CLIENT :-	DRAWN KBP 1.8.13	DESCRIPTION:-
CONSULTANT :-	APP'D HPB 1.8.13	FLAMEPROOF WEATHERPROOF
P.O.NO. :-	CH'D NPB 1.8.13	JUNCTION BOX / ENCLOSURE
KAYSONS 1802/7, G.I.D.C. ESTATE, V.U.NAGAR 388121. (GUJARAT)		SHT.NO. 1 OF 1 REV. 0 DRG.NO.:- I07

THE INFORMATION CONTAINED IN THIS DRAWING IS THE PROPERTY OF KAYSONS TECHNO EQUIPMENTS PVT. LTD. AND IS NOT TO BE COPIED OR MISUSED IN ANY WAY.

ISSUE	DATE	BY	MODIFICATION