

CMRI CERT NO.:-- CIMFR/TC/P/H619
 SUPPLE. T.C. NO.:-- CIMFR/TC/S/H161
 CAT.NO.:-- KCP-09-C-JB

TECHNICAL DATA

ENCLOSURE :-
 EX-d AS PER IS/IEC 60079-1:2007
 SUITABLE FOR INSTALLATION IN HAZARDOUS LOCATION

PROTECTION :-
 IP-66 AS PER IS/IEC (60529:2001)

AREA CLASSIFICATION :-
 ZONE -1 & 2

GAS GROUPS :-
 IIC

TEMPERATURE CLASS :-
 T6

MATERIAL OF CONSTRUCTION :-
 CAST AL ALLOY LM-6



GASKET :-
 MOLDED NEOPRENE

HARDWARE :-
 STEEL ZINC PLATED/STAINLESS STEEL

FINISH :-
 YELLOW

EARTHING :-
 1 NO. INSIDE & 2 NOS. OUTSIDE

CABLE ENTRY :-
 TO BE SPECIFIED WHILE ORDERING.

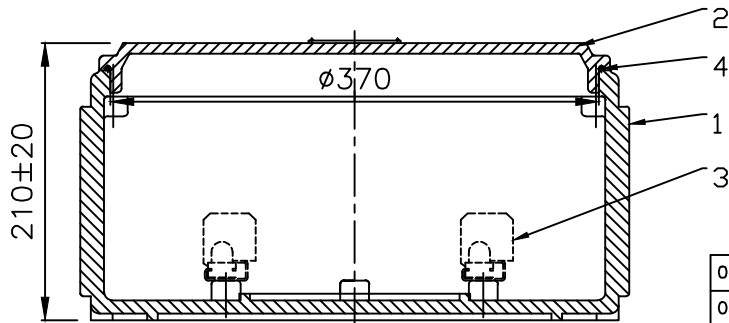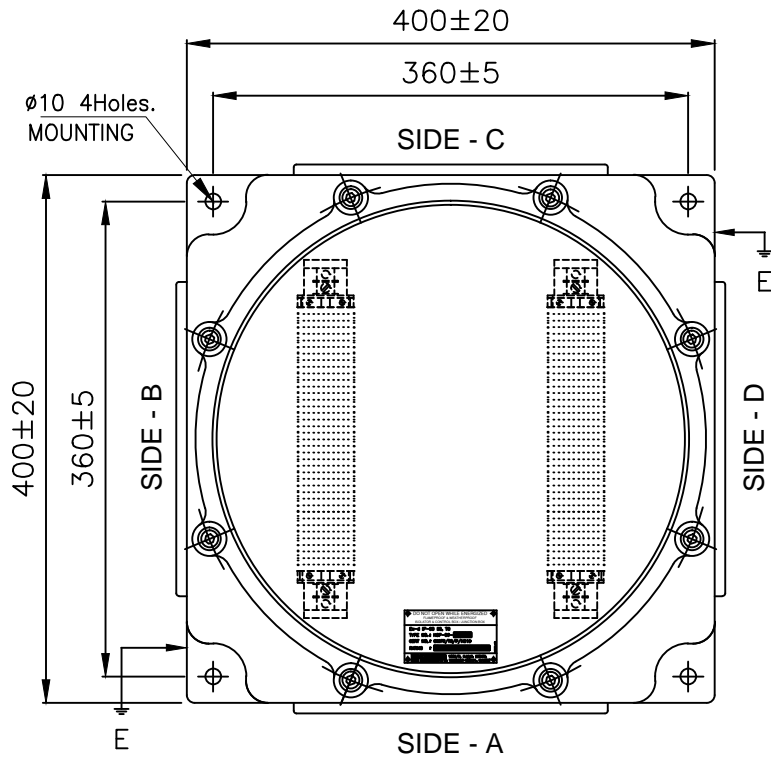

CABLE ENTRY & TERMINAL DETAILS

SIDE-A	SIDE-B	SIDE-C	SIDE-D	NO. OF CABLE ENTRY	NO. OF TERMINAL	QTY.

04.	GASKET (ENDLESS, MOULDED)	1	NEOPRENE								
03.	TERMINAL	A.R.	CLIPON TYPE								
02.	COVER	1	CAST AL. ALLOY								
01.	BODY	1	CAST AL. ALLOY								
NO.	DESCRIPTION	QTY	MAT./RATING	SR. NO.	TAG NO.	NO. OF CABLE ENTRY				NO. OF TERMINAL	QTY.

THE INFORMATION CONTAINED IN THIS DRAWING IS THE PROPERTY OF KAYSONS TECHNO EQUIPMENTS PVT. LTD. AND IS NOT TO BE COPIED OR MISUSED IN ANY WAY.

ISSUE	DATE	BY	MODIFICATION

CLIENT :-
 CONSULANT :-
 P.O.NO. :-

DRAWN KPB 1.8.13
 APP'D HPB 1.8.13
 CH'D NPB 1.8.13

KAYSONS 1802/7, G.I.D.C. ESTATE,
 TECHNO EQUIPMENTS PVT LTD V.U.NAGAR 388121. (GUJARAT)

DESCRIPTION:-
FLAMEPROOF WEATHERPROOF JUNCTION BOX

SHT.NO. 1 OF 1
 REV. 0
 DRG.NO.:-- J06